



Sales & Service for Standby Engine Generators

Generator Maintenance Log For

**Anton Paar QuantaTec
Generac Generator 150KW
Model: SD0150
Serial: 2113647**

**For Emergency Service Call:
954-956-9252
Toll Free 1-866-9-GENSET(943-6738)**



Sales & Service for Standby Engine Generators

CUSTOMER

ANTON PAAR QUANTATEC

GENERATOR MODEL # 500150

GENERATOR SERIAL # 2113647

	2022 2					2023		2024				
DATE	1/12	3/8	6/10	9/21	12/7	2/21	1/24	3/11	4/4	6/18	04 DEC	
UNIT HOURS	239.8	243.3 243.6	248.1 248.4	253.6 253.9	261.3 261.6	268.7 269		288.2 288.6	292.8	296.5 296.8	303.8 304.2	
GENERAL VISUAL	TANK RUST	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
LEAKS	Ø	Ø	NONE	NONE	Ø	NONE	Ø	Ø	Ø	Ø	NONE	
COOLANT LEVEL	OK	100% OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
WATER TEMPERATURE	165	170	170	170	170	170	170	158	158	170	158°	
OIL PRESSURE	81	80	79	80	80	80	81	78	78	75	71 PSI	
OIL LEVEL	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
BATTERY LEVEL	OK	13.0 OK	OK	OK	13.0 OK	OK	OK	F/U	F/U	13.0 OK	F/U	
BATTERY CHARGER	OK	13.4 OK	OK	OK	OK	OK	OK	OK	OK	14.2 OK	1.6	
FUEL TANK LEVEL	13"	13"	58%	92%	3/4	3/4	98.1	78%	FULL	17"	17"	
FUEL TANK EXTERIOR	RUST	OK	OK	OK	OK	OK	OK	OK	NONE	OK	OK	
FUEL TANK CONTAINMENT	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
DAYTANK LEVEL	Ø	N/A	/	/	Ø	NA	N/A	/	/	/	NA	
GENERATOR TEST	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES	
LOAD TRANSFER	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	
VOLTAGE	208	208	208	208	208	208	206	208	208	208	208	
AMPS	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	
FREQUENCY	60.0	60.0	60	60	60	60	60	60.0	60	60.0	60.0	
TECHNICIAN	MV	EB	CH	RS	Jt	RS	Jt	MV	Jt	EB	Jt	
NOTES (SEE BACK)	✓						✓	✓	✓	✓	✓	

1-12-2022: FUEL TANK HAS HEAVY SURFACE RUST.
RECOMMEND FUEL SUPPLY AND RETURN
LINES.

2/14/22 S/C - Fuel supply & Return hoses. DONE - 2H
PAINTED, CLEAN & ^{RUST} SEAT FUEL TANK EB. 3/8/22

9-21-2022 - H-Paul's Right Side Chirp - Scrambled - Stabilized aft after a
few minutes - ???

06-21-23 - Ref Engine Battler.

10/29/23 - F/U Bats ↑

1-11-24: BATTERY DUE

4/4/24 ↑ F/U Bats

04 DEC 2004 F/U BATTERIES, AIR FILTER & PAINT TANK & FRAME



Sales & Service for Standby Engine Generators

CUSTOMER _____

GENERATOR MODEL # _____

GENERATOR SERIAL # _____

	2017	2018	2019						2020	2021		
DATE	11/27	1/15	5/10	8/10	11/13	2/5	4/12	9/4		3/3	11/12	05 OCT
UNIT HOURS	147.3	150.1 150.4	156.3	162.6 162.9	168.4 168.7	173.1 173.4	177.0 177.3	184.6 184.9		221.4 221.9	231.7	234.4 234.7
GENERAL VISUAL	OK	OK	OK	OK	OK	OK	OK	OK		OK	OK	OK
LEAKS	Ø	NONE	Ø	NONE	Ø	Ø	Ø	Ø		Ø	Ø	NONE
COOLANT LEVEL	OK	OK/FU	NEW	OK	OK	OK	OK	OK		OK 9.5"	OK	OK
WATER TEMPERATURE	161	163°	176	176	176	176	170	170		170	180	172°
OIL PRESSURE	79	78 PSI	75	75	73	77	77	77		77	75	79 PSI
OIL LEVEL	OK	OK	OK	change	OK	OK	OK	OK		OK	OK	OK
BATTERY LEVEL	F/U	OK/FU	NEW	OK	OK	OK	OK	OK		OK 8.8"	OK	OK 8.8"
BATTERY CHARGER	OK	.9	OK	OK	OK	OK	OK	OK		OK 0.4.3	OK	.7
FUEL TANK LEVEL	7/8	11"	3/4	FULL	3/4	62%	60%	1/2		3/4	7/8	15"
FUEL TANK EXTERIOR	OK	OK	OK	OK	OK	OK	OK	OK		OK	OK	OK
FUEL TANK CONTAINMENT	OK	OK	OK	OK	OK	OK	OK	OK		OK	OK	OK
DAYTANK LEVEL	NA	NA	NA	NA	NA	NA	NA	NA		NA	NA	NA
GENERATOR TEST	YES	YES	YES	YES	YES	YES	YES	YES		YES	YES	YES
LOAD TRANSFER	NO	NO	NO	NO	NO	NO	NO	NO		NO	NO	NO
VOLTAGE	209	208	209	208	208	208	208	208		208	209	208
AMPS	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø		Ø	Ø	Ø
FREQUENCY	60.0	60	60.0	60.0	60.0	60	60.0	60		60.0	60.0	60.0
TECHNICIAN	MM	John C	MH	LH	EB	RS	MH	LH		EB	Don P	John S
NOTES (SEE BACK)	✓	YES	YES							DATE		YES

TVE 800 - 20 min

11-27-17: FUEL LINES, BELTS, HOSES, BATTERYS,
BLOCK HEATER. COOLANT.

01/15/2018 9 PLUS AIR FILTER

5/10/18 Replaced fuel lines, Belt, Hoses, Batteries, Block Heater,
& COOLANT.

F/U still needs A.F.

CHANGED BATTERIES EB. 3/4/21

05 OCT 2021 - F/U FUEL TANK 25% ~~25%~~

TANK INFO

APPROX		MFG GENERAL	
F -	22	MODEL - 57849	
$\frac{7}{8}$ -	$19\frac{1}{4}$	SN - 144660	
$\frac{3}{4}$ -	$16\frac{1}{2}$	CAP. 333 GL	
$\frac{5}{8}$ -	$13\frac{3}{4}$		
$\frac{1}{2}$ -	11		
$\frac{3}{8}$ -	$8\frac{1}{4}$		
$\frac{1}{4}$ -	$5\frac{1}{2}$		
$\frac{1}{8}$ -	$2\frac{3}{4}$		
E -	0		

[Handwritten scribbles]



Sales & Service for Standby Engine Generators

CUSTOMER

Pentachrome Instruments

GENERATOR MODEL # SDO150

GENERATOR SERIAL # 2113647

	2014		2015		2016		*2017*					
DATE	10/16	01/26	5/5	7/30	10/26	1/5	03/30	7/26	10/28	1.23	06/07	8/10
UNIT HOURS	69.8 70.1	75.0 75.3	80.5 80.8	85.2 85.5	89.7 90.0	94.7	99.7 99.0	105.1 105.5	111.0 111.3	115.5 115.9	124.9 125.2	128.6
GENERAL VISUAL	good	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK
LEAKS	NONE	NONE	NONE	NONE	NONE	NONE	NONE	Ø	Ø	Ø	NONE	Ø
COOLANT LEVEL	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK/FU	OK
WATER TEMPERATURE	165°	164°	161°	174°	172°	160	165	181	170	168	176°	168
OIL PRESSURE	77psi	78psi	80	78psi	76psi	79	76	76	77	77°	74psi	78
OIL LEVEL	OK	OK	OK	OIL CHANGE	OK	OK	OK	O/C	OK	OK	OK	changed OK
BATTERY LEVEL	13.1 10.5	F/U	DEW 13.6x2 12.8	OK	OK	OK	OK	OK	OK	OK	OK/FU	OK
BATTERY CHARGER	1.41 14.5	1.7	8.4 14.3	1.5	.5	1	.7	OK	OK	OK	.9	OK
FUEL TANK LEVEL	15 1/2" 77%	14 1/2"	14"	14"	21"	100%	19"	7/8"	3/4	3/8"	14 1/2"	14"
FUEL TANK EXTERIOR	Rust no OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	Rust
FUEL TANK CONTAINMENT	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK
DAYTANK LEVEL	NA	NA	NA	NA	NA	N/A	NA	/	/	NA	NA	N/A
GENERATOR TEST	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES
LOAD TRANSFER	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO
VOLTAGE	208	208	208	208	208	208	208	208	208	208	208	208
AMPS	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø
FREQUENCY	60.0	60.0	60.0	60	60	60	60.0	60.0	60.0	60.0	60	60
TECHNICIAN	Robbie S	John S	Robbie S	John S	John S	FG	John S	MV	MV	KK	John S	MH
NOTES (SEE BACK)		#1					#2		✓		#2	

01-26-15 F10#1 - BATTERIES DOWE-S-S-15 Robbier. DST

03-30-16 F10#2 FUEL HOSES & BLOCK HEATERS? HET & HOSES & COOLANT

10-28-16: BACK HEATER

1-23-17 F10 Batts NEXT pm

06-07-17 F10#4 AGAIN PLUS BATTERIES

08-10-17 - Batteries 2-31's, fuel hoses, coolant hoses & Belts, & Block Heaters.

WROTE UP BATTs; PAINT & EXERCISER NOT WORKING EB 3/3/21



TEST REPORT
=BATTERY TEST=
FLOODED

VOLTAGE: 13.03V
RATED: 950CCA
MEASURED: 1825CCA
IR: 1.64mΩ
TEMP: 0 F / -17 C

GOOD 2 PASS

STATE OF HEALTH



STATE OF CHARGE



CODE
BFN03PPPHGAOXE 2
CLIENT:

TEST DATE:
2025/04/17
17:04:17

BY:




TEST REPORT
=BATTERY TEST=
FLOODED


VOLTAGE: 13.03V
RATED: 950CCA
MEASURED: 1649CCA
IR: 1.81mΩ
TEMP: 0 F / -17 C

GOOD 2 PASS

STATE OF HEALTH

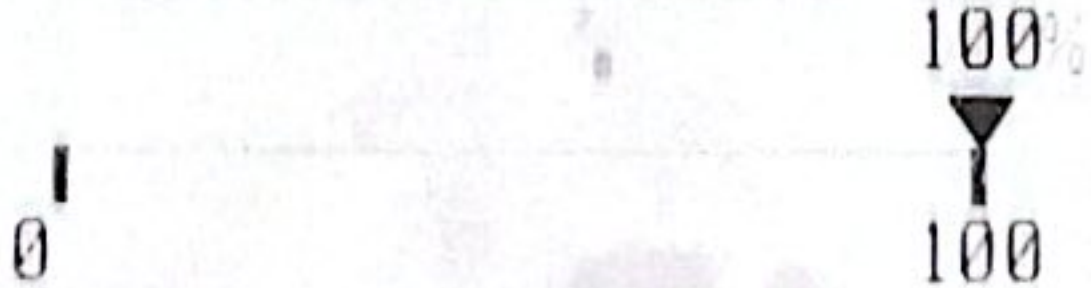

STATE OF CHARGE

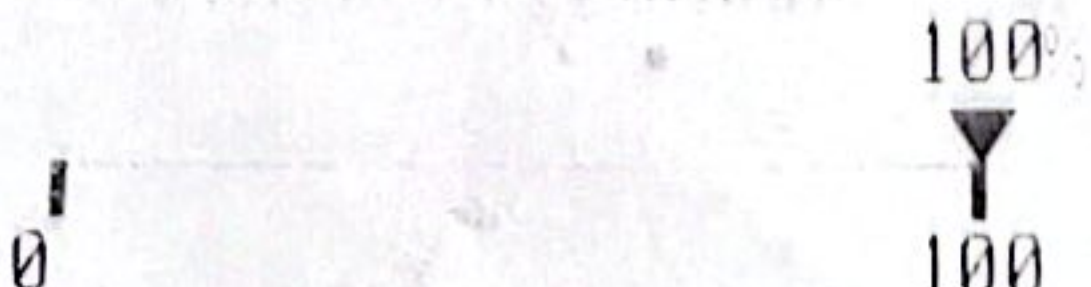

CODE
35V03PPFHGP69E 2
CLIENT:

TEST DATE:
2025/04/17
17:05:30

BY: